

PRODUCT INFORMATION LEWABRANE® RO B400 ULP ASD



The Lewabrane® spiral wound reverse osmosis (RO) element RO B400 ULP ASD has a highly permeable composite polyamide (PA) membrane. It is designed for low salinity water to operate at ultra low pressure (ULP). The high permeability results in up to 40% lower energy consumption compared to standard elements like the RO B400 HR. The ASD (Alternating Strand Design) feed spacer offers a lower fouling tendency to improve the RO lifetime cost performance. The elements are characterized by


- High rejection of organic compounds
- Low energy demand
- Low fouling tendency due to ASD feed spacer

General Information

	Metric units	US units
Permeate flow, ave.	38.6 m ³ /d	10200 gpd
Salt rejection, ave.	99.5 %	99.5 %
Membrane area	37.2 m ²	400 ft ²
Feed spacer thickness	0.86 mm (ASD spacer)	34 mil (ASD spacer)

Minimum element performance: 31.1m³/d (8200 gpd) permeate flow and 99.0% salt rejection
Element is tested under the following conditions: applied pressure 7.6 bar (110 psi), NaCl concentration 500 mg/l, operating temperature 25 °C (77 °F), pH 7 and recovery rate 15%

Element Dimension

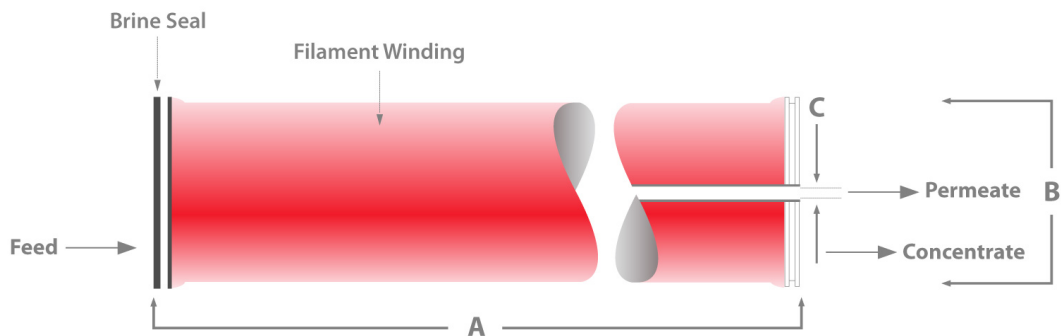

	A (Length)	B (Diameter)	C (ID)
Dimension inches (mm)	40 (1016)	7.9 (201)	1.125 (29)

This document contains important information and must be read in its entirety.

Edition: 2017-03-30
Previous Edition: 2016-09-06

Application Data

	Metric units	US units
Operating pressure, max.	41 bar	600 psi
Operating temperature, max.	45 °C	113 °F
Feed water SDI, max.	5	5
pH range during operating	2 - 11	2 - 11
pH range during cleaning	1 - 12	1 - 12
Pressure drop per element, max.	1.0 bar	15 psi
Pressure drop per vessel, max.	3.5 bar	50 psi
Chlorine concentration, max.	0.1 ppm	0.1 ppm

Additional Information

- Treat RO Elements with care; do not drop the element.
- Each RO Element is wet tested, preserved in a 1% weight sodium bisulfite solution, and vacuum packed in oxygen barrier bags.
- During storage, avoid freezing and direct sunlight. The temperature should be below 35 °C (95 °F).

After Installation

- Keep the RO Elements wet, and use a compatible preservative for storage duration longer than 7 days.
- During the initial start up, discharge the first permeate to drain for 30 min.
- Permeate back pressure should not exceed feed pressure at any time.
- The RO Elements shall be maintained in a clean condition, unfouled by particulate matter or precipitates or biological growth.
- Consider cleaning, if the pressure drop increases by 20% or water permeability decreases by 10%. Use only chemicals which are compatible with the membrane.
- For additional information consult the Lewabrane® technical information available at www.lpt.lanxess.com.

This information and our technical advice – whether verbal, in writing or by way of trials – are given in good faith but without warranty, and this also applies where proprietary rights of third parties are involved. Our advice does not release you from the obligation to check its validity and to test our products as to their suitability for the intended processes and uses. The application, use and processing of our products and the products manufactured by you on the basis of our technical advice are beyond our control and, therefore, entirely your own responsibility. Our products are sold in accordance with the current version of our General Conditions of Sale and Delivery.

LANXESS Deutschland GmbH
Liquid Purification Technologies
Kennedyplatz 1
D-50569 Köln

www.lpt.lanxess.com

This document contains important information and must be read in its entirety.